CODEGREEN ITM

RELEASE 2026.10

THE NFPA 72 RECORD OF COMPLETION

Built from your system. Not a blank form.

Joe, our NICET Level IV fire alarm technician, built it to NFPA 72. It reads the panels, circuits and property already in CodeGreen, fills in what is relevant, and asks only for what is missing.

A REAL PRINTED RECORD

4.1 Control unit (lobby)

Manufacturer: Firelite Model number: MS-9600UDLS

4.2 Software and firmware

Firmware revision number: 1.1

4.3 Alarm verification

☒ This system does not incorporate alarm verification.

Number of devices subject to alarm verification: - Alarm verification set for (seconds): -

5. SYSTEM POWER

5.1 Control unit (lobby)

5.1.1 Primary power

Input voltage of control panel: 120 VAC Control panel amps: 3.25 A

Overcurrent protection: type: Circuit Breaker Amps: 20 A

Branch circuit disconnecting means location: First floor Number: 12

5.1.2 Secondary power

Type of secondary power: Batteries: 12 V, 7Ah x 2

Location, if remote from the plant: In Panel Cabinet

Calculated capacity: standby mode (hours): 24 Alarm mode (minutes): 5


5.2 Power extender panels

☒ This system does not have power extender panels.

☐ Power extender panels are listed on the Notification Appliance Power Panels supplement.

6. CIRCUITS AND PATHWAYS

Pathway type	Dual media pathway	Separate pathway	Class	Survivability level
Signaling Line Circuit (SLC)	N/A	N/A	Class B	Level 0
Device Power	N/A	N/A	N/A	N/A
Initiating Device Circuit (IDC)	N/A	N/A	N/A	N/A
Notification Appliance Circuit (NAC)	N/A	N/A	Class B	Level 0

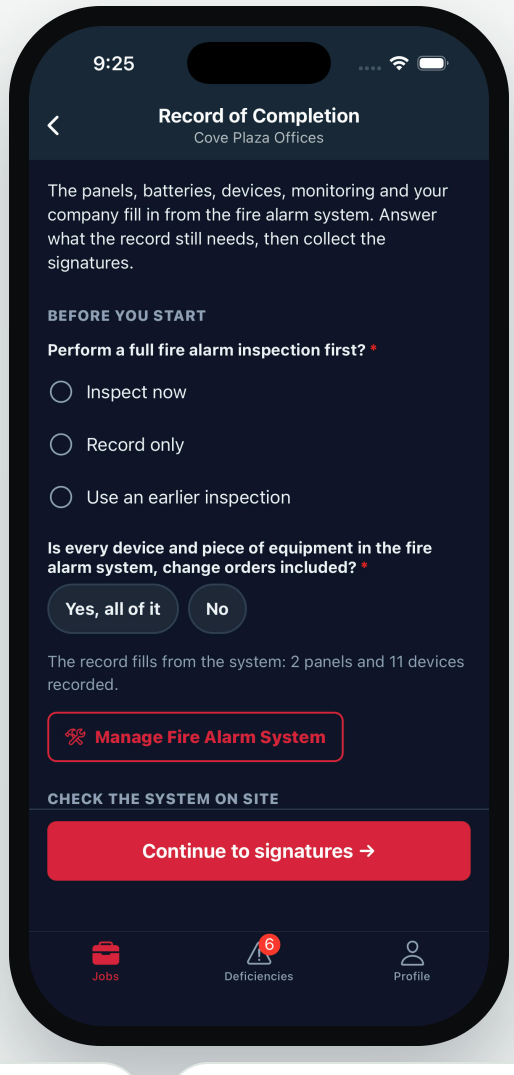

+ Record of Completion
+ Review a whole account
+ One package per account
+ Suggested control devices
+ Import asks first
+ Photo rules per service
+ Lists that remember

Built by a NICET Level IV fire alarm technician and a software engineer. **We speak your language.**

30 days free · No credit card

codegreenitm.com


CODEGREEN ITM

RECORD OF COMPLETION


Tick one box when you book it.

Booking an acceptance test? Tick **Record of Completion** on the visit. On the phone it becomes its own job, ready to start.

IN THE OFFICE

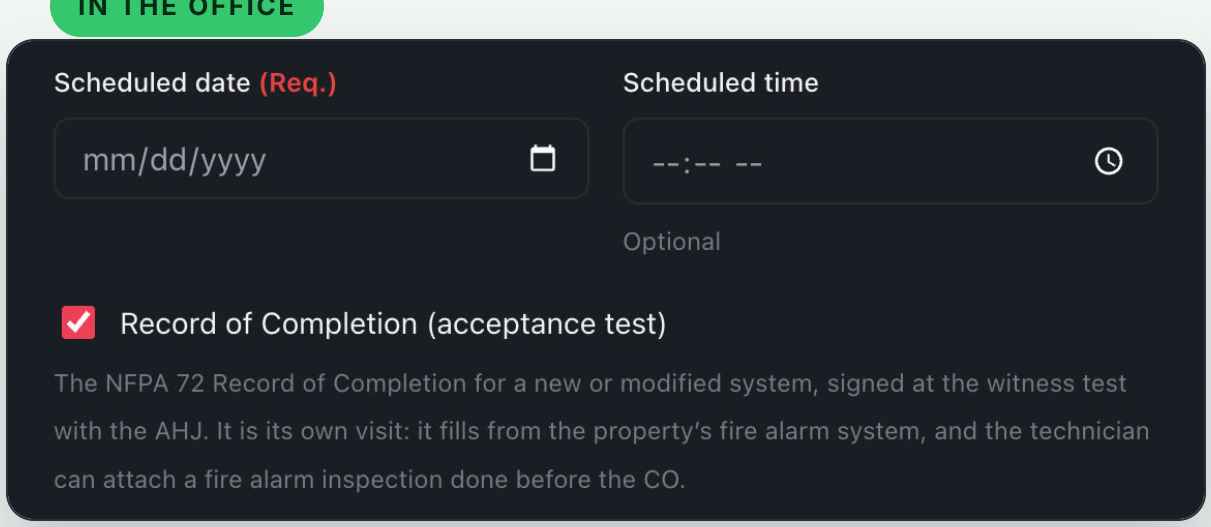

ON THE PHONE

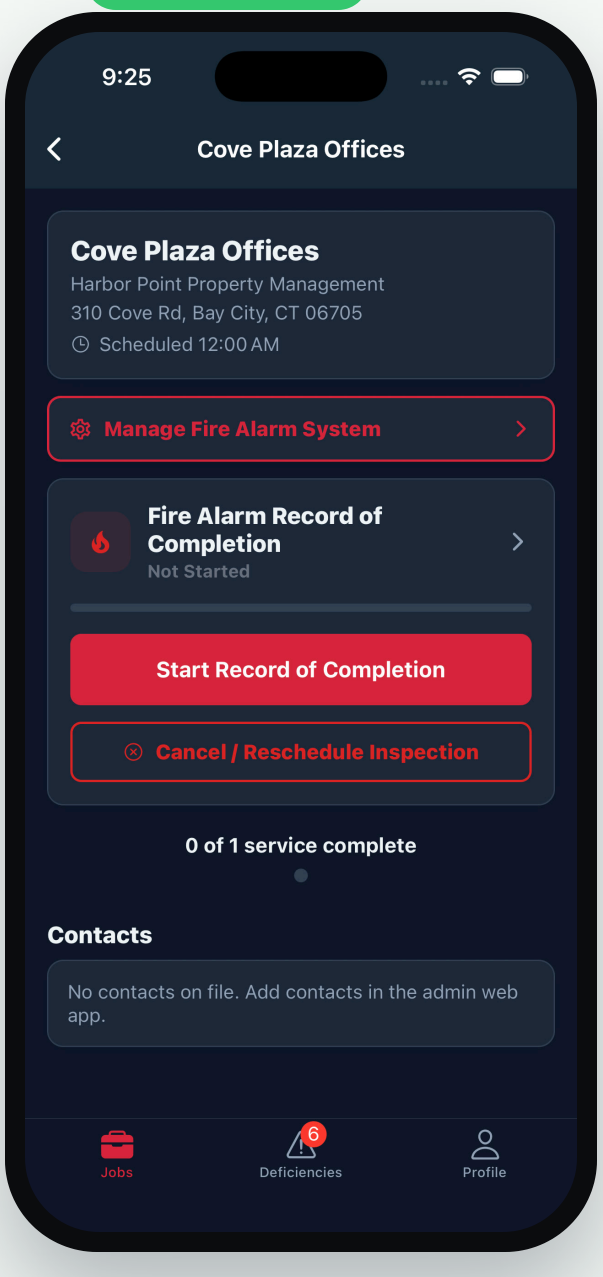

Real screens from our demo company, not mock-ups.

Fire and life safety inspection software.
Built by people who do this work.


codegreenitm.com

CODEGREEN ITM

RECORD OF COMPLETION

It fills itself in from your system.

Panels, branch circuits, batteries, pathways, occupancy and construction type come from what you already keep in CodeGreen, printed in NFPA 72's own section order.

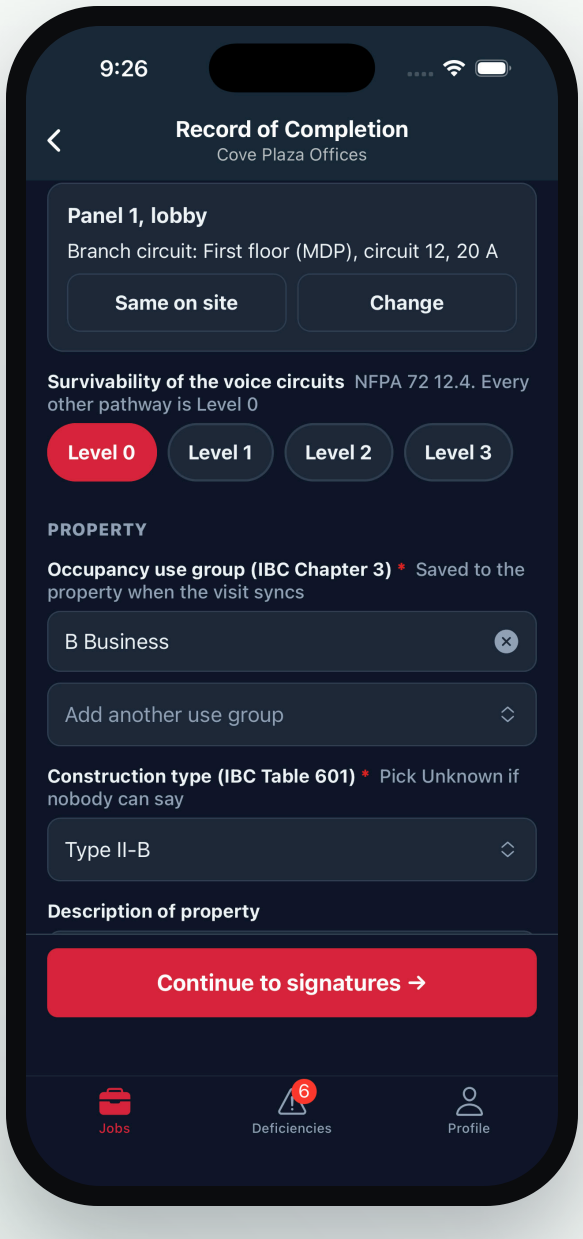

PAGE 2 OF THE PRINTED RECORD

4.1 Control unit (lobby)

Manufacturer: Firelite Model number: MS-9600UDLS

4.2 Software and firmware

Firmware revision number: 1.1

4.3 Alarm verification

☒ This system does not incorporate alarm verification.

Number of devices subject to alarm verification: - Alarm verification set for (seconds): -

5. SYSTEM POWER

5.1 Control unit (lobby)

5.1.1 Primary power

Input voltage of control panel: 120 VAC Control panel amps: 3.25 A

Overcurrent protection: type: Circuit Breaker Amps: 20 A

Branch circuit disconnecting means location: First floor Number: 12

5.1.2 Secondary power

Type of secondary power: Batteries: 12 V, 7Ah x 2

Location, if remote from the plant: In Panel Cabinet

Calculated capacity: standby mode (hours): 24 Alarm mode (minutes): 5

5.2 Power extender panels

☒ This system does not have power extender panels.

☐ Power extender panels are listed on the Notification Appliance Power Panels supplement.

6. CIRCUITS AND PATHWAYS

Pathway type	Dual media pathway	Separate pathway	Class	Survivability level
Signaling Line Circuit (SLC)	N/A	N/A	Class B	Level 0
Device Power	N/A	N/A	N/A	N/A
Initiating Device Circuit (IDC)	N/A	N/A	N/A	N/A
Notification Appliance Circuit (NAC)	N/A	N/A	Class B	Level 0

The branch circuit, occupancy and construction type on the phone were filled in before anyone typed.

Fire and life safety inspection software.
Built by people who do this work.


codegreenitm.com

CODEGREEN ITM

RECORD OF COMPLETION

It asks only what is missing.

Inspect now, record only, or use an earlier inspection. Then a permit number and a line about the work. Built by Joe from his own NFPA 72 field work.

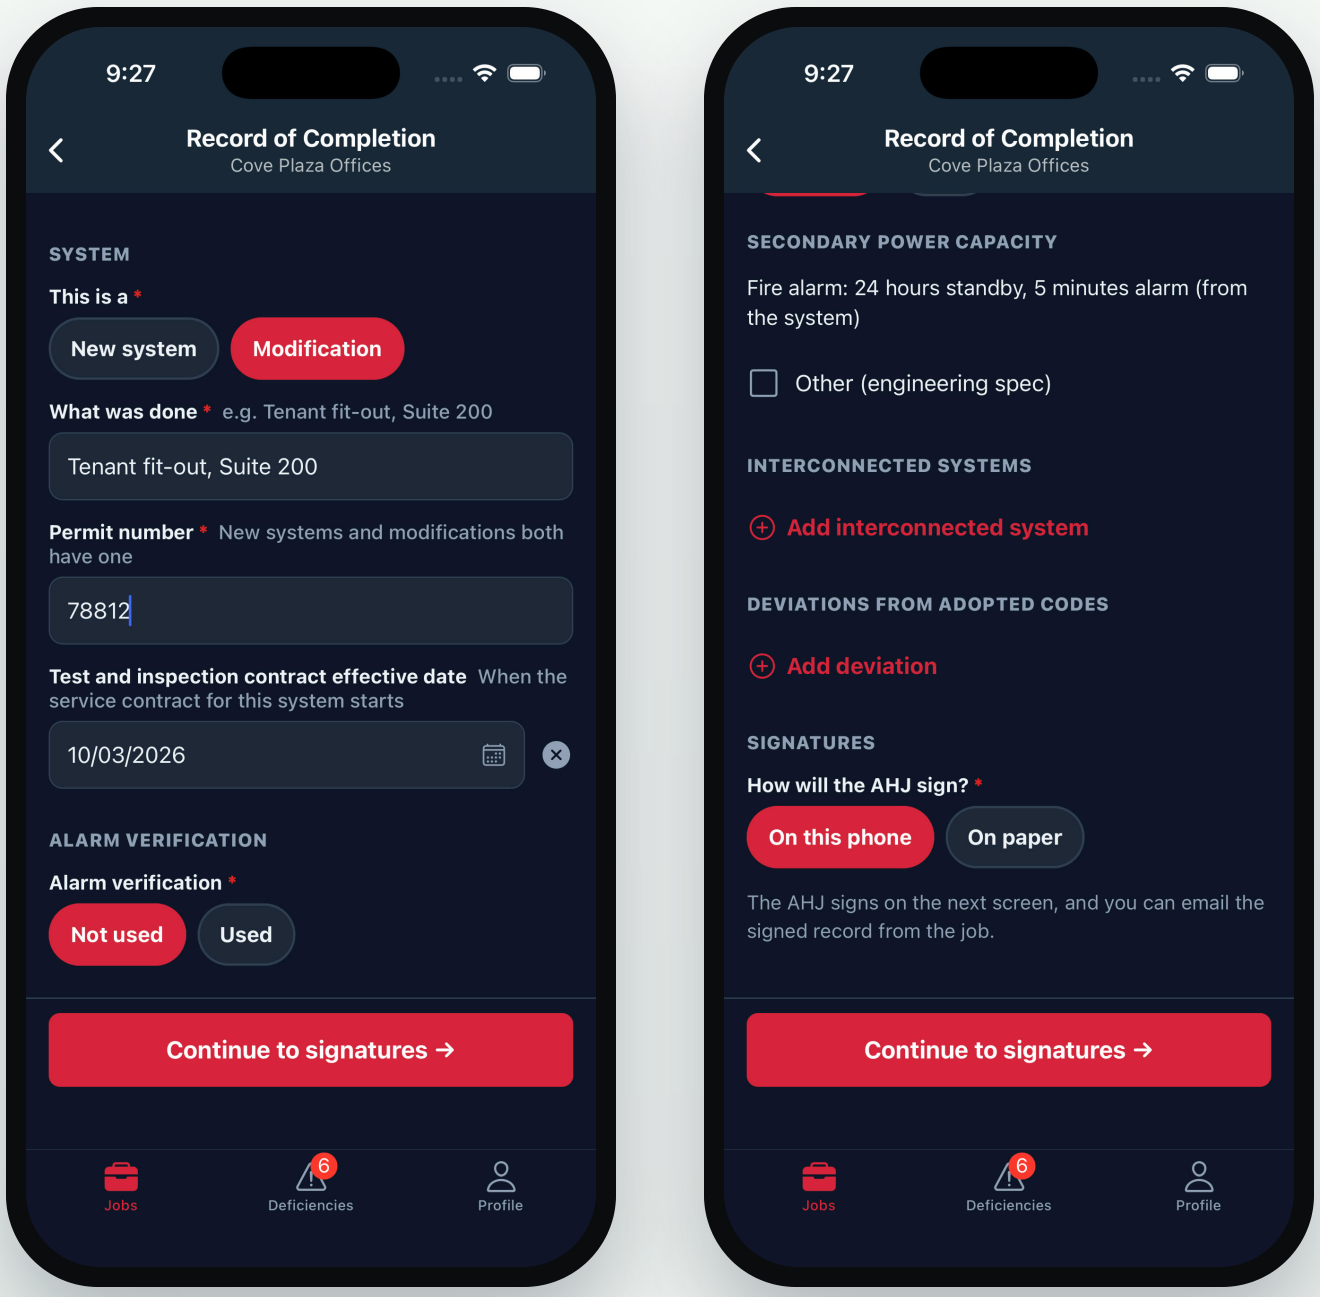

Standby and alarm capacity read straight from the system: 24 hours, 5 minutes.

Fire and life safety inspection software.
Built by people who do this work.


codegreenitm.com

CODEGREEN ITM

RECORD OF COMPLETION

Signed on site.
Sent from the job.

The installer, the AHJ and the owner sign on the phone, or on paper. The owner's name comes from the property. Email the signed record before you leave.

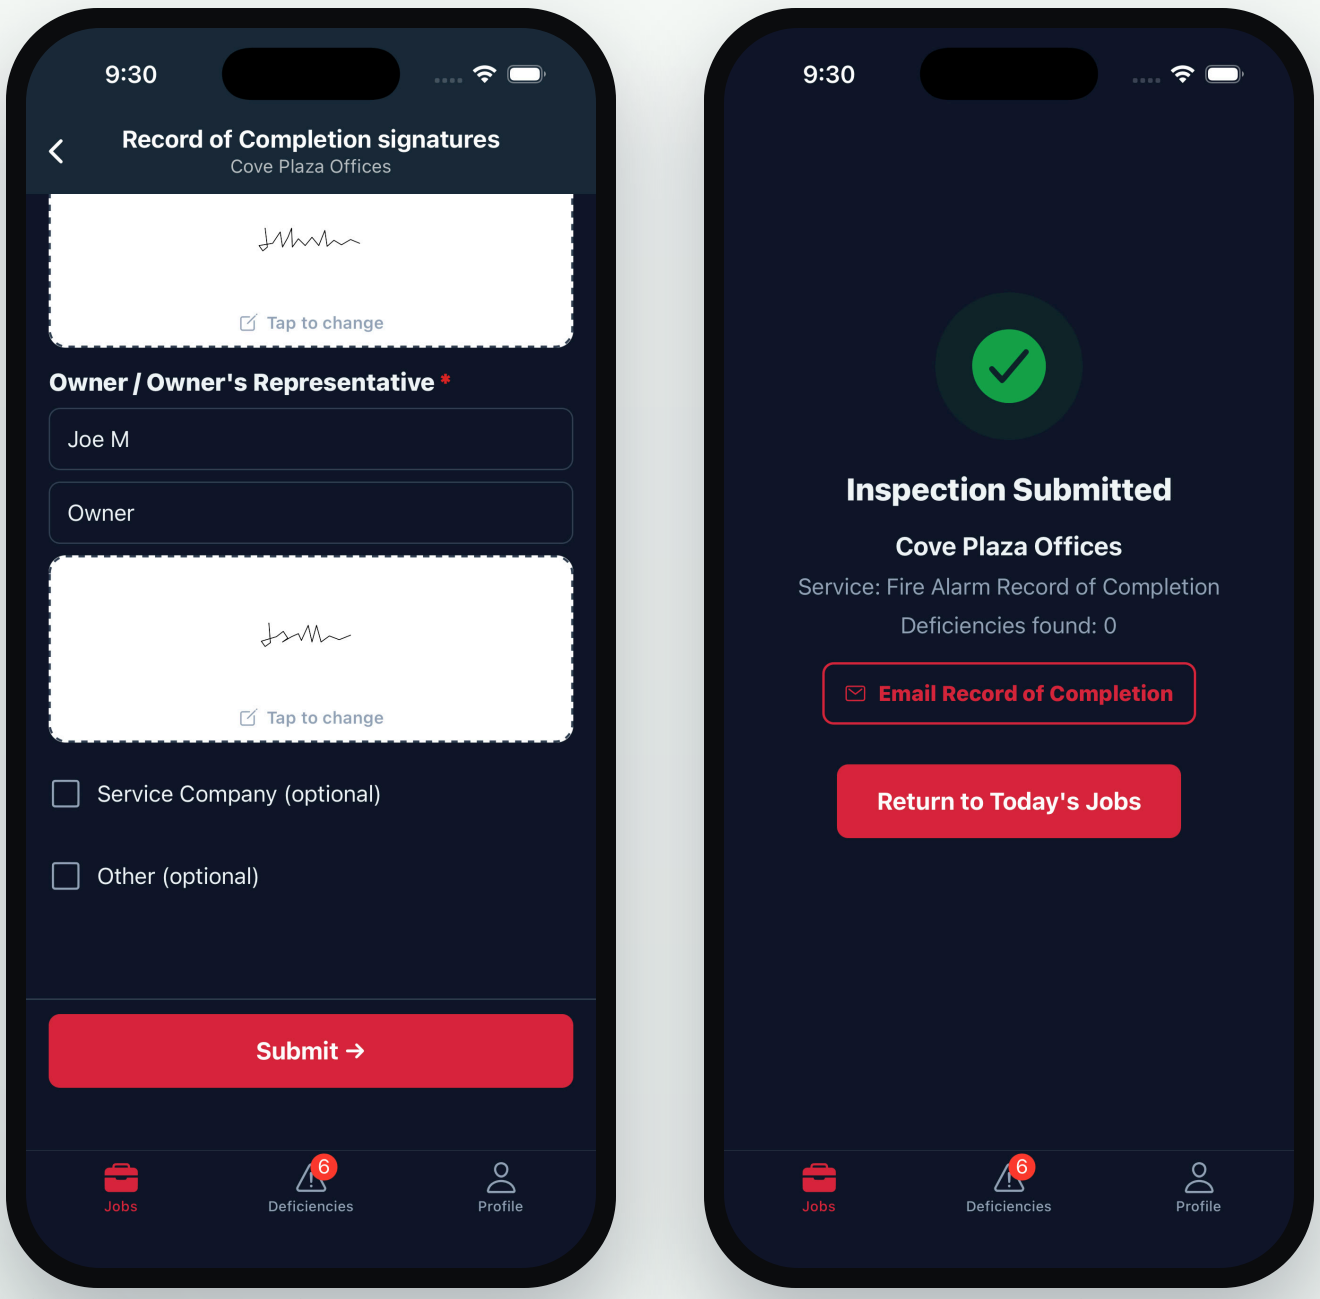

Signed on paper instead? Photograph the pages and they go with the record.

Fire and life safety inspection software.
Built by people who do this work.


codegreenitm.com

CODEGREEN ITM

ACCOUNTS

One page.
A whole account reviewed.

On an account, **Review 6 waiting** opens every property's inspections on one page. Mark them reviewed one at a time or all together, then send one package.

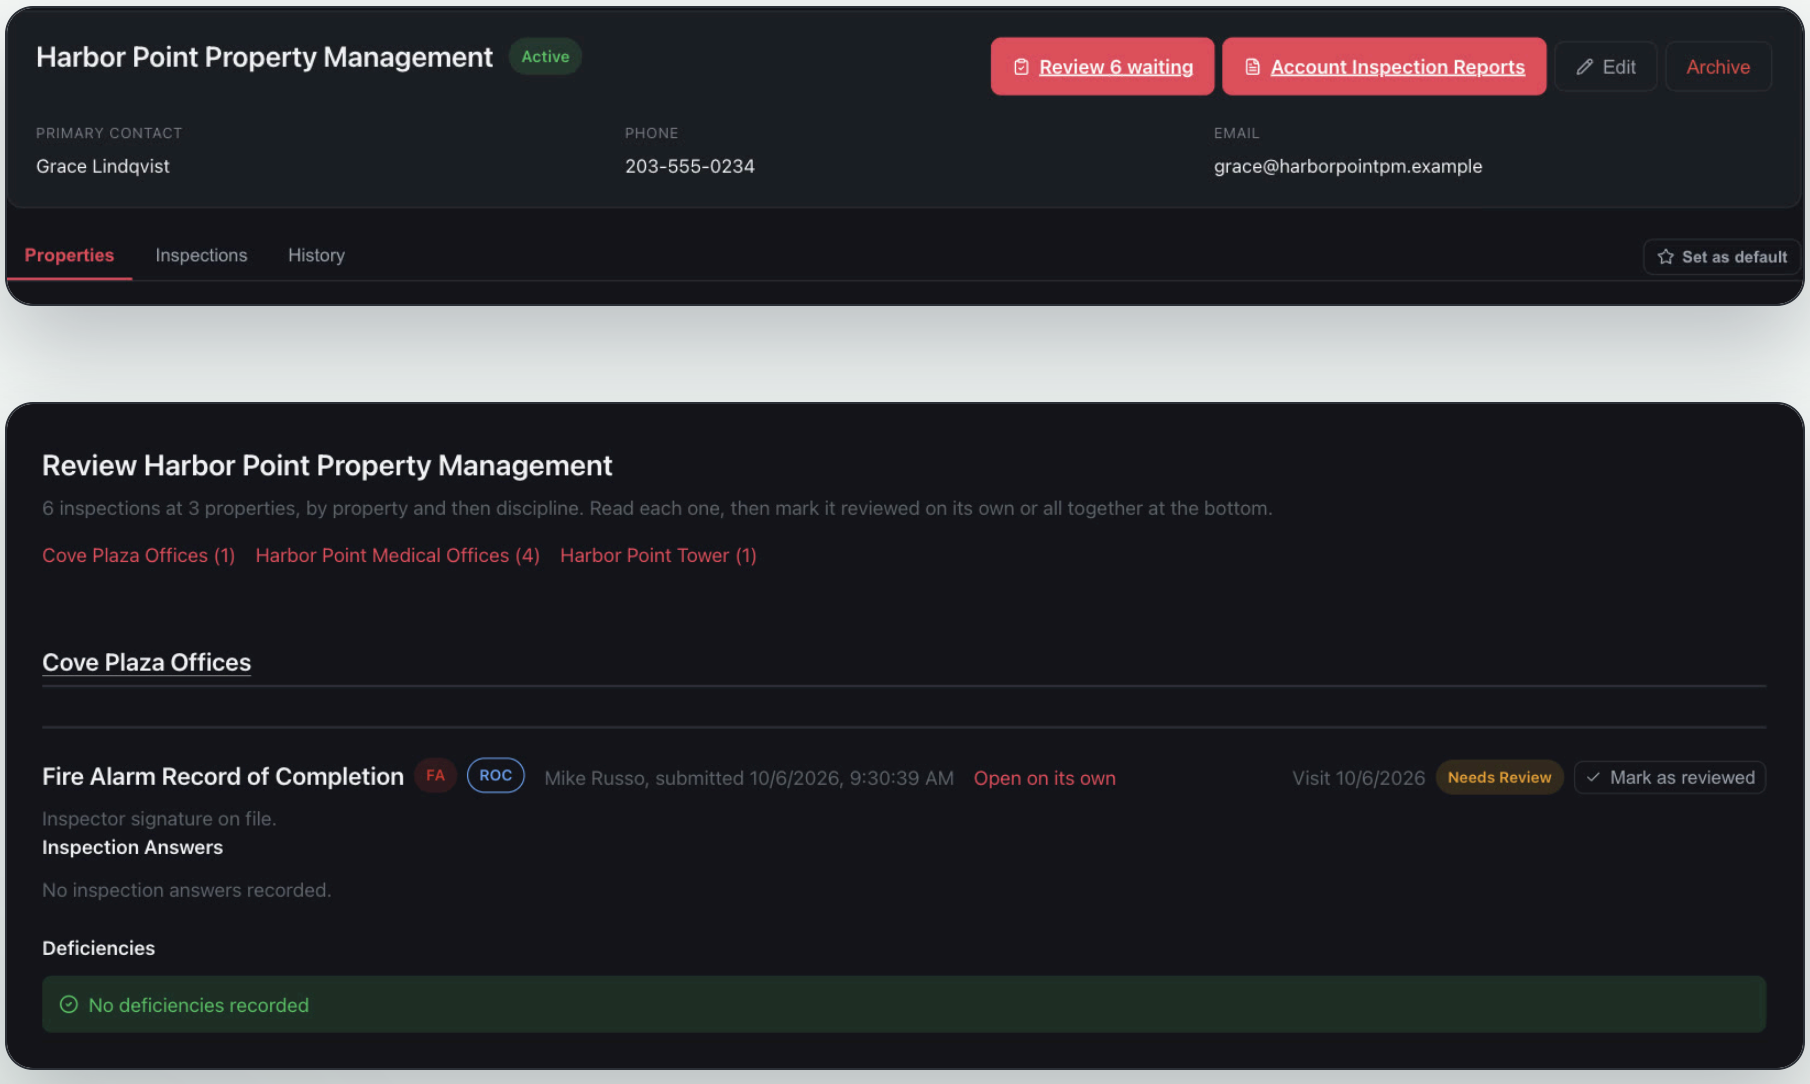

Then send the account as one combined PDF, a zip of the reports, or both.

Fire and life safety inspection software.
Built by people who do this work.

codegreenitm.com


CODEGREEN ITM

FIRE ALARM SETUP


Fire alarm setup that knows the code.

Suggested control devices proposes what the building calls for, with the NFPA 72 section. **Import Devices** asks how you want the list before it goes in.

SUGGESTED CONTROL DEVICES

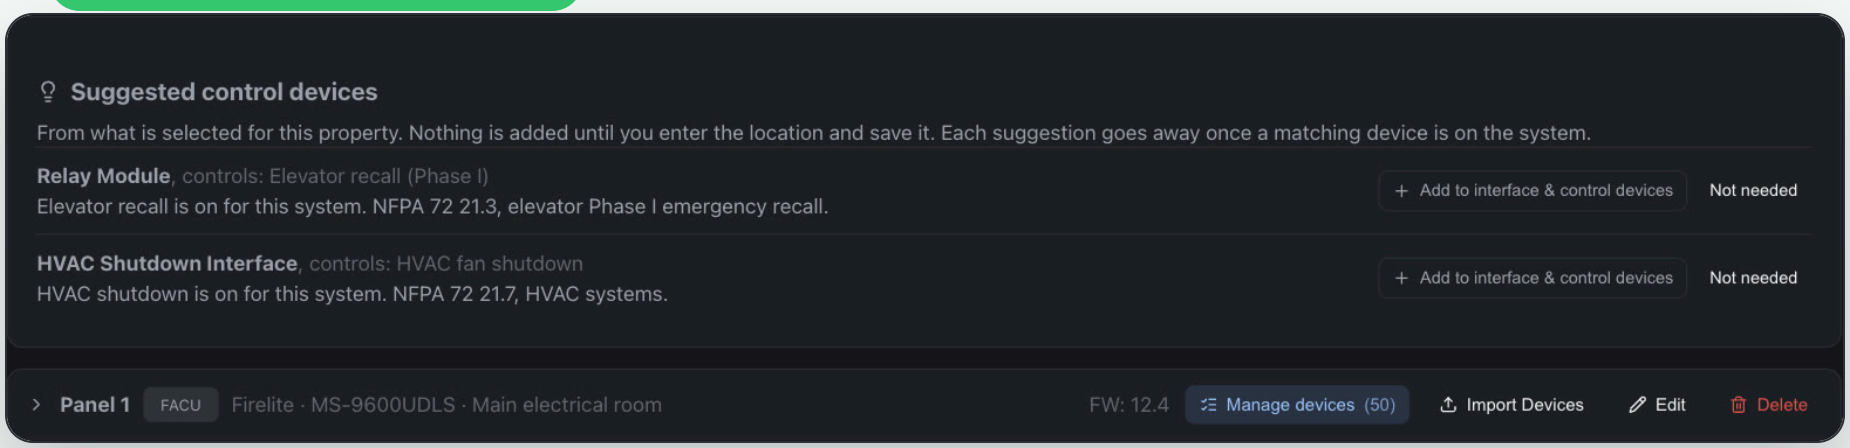

IMPORT DEVICES ASKS FIRST

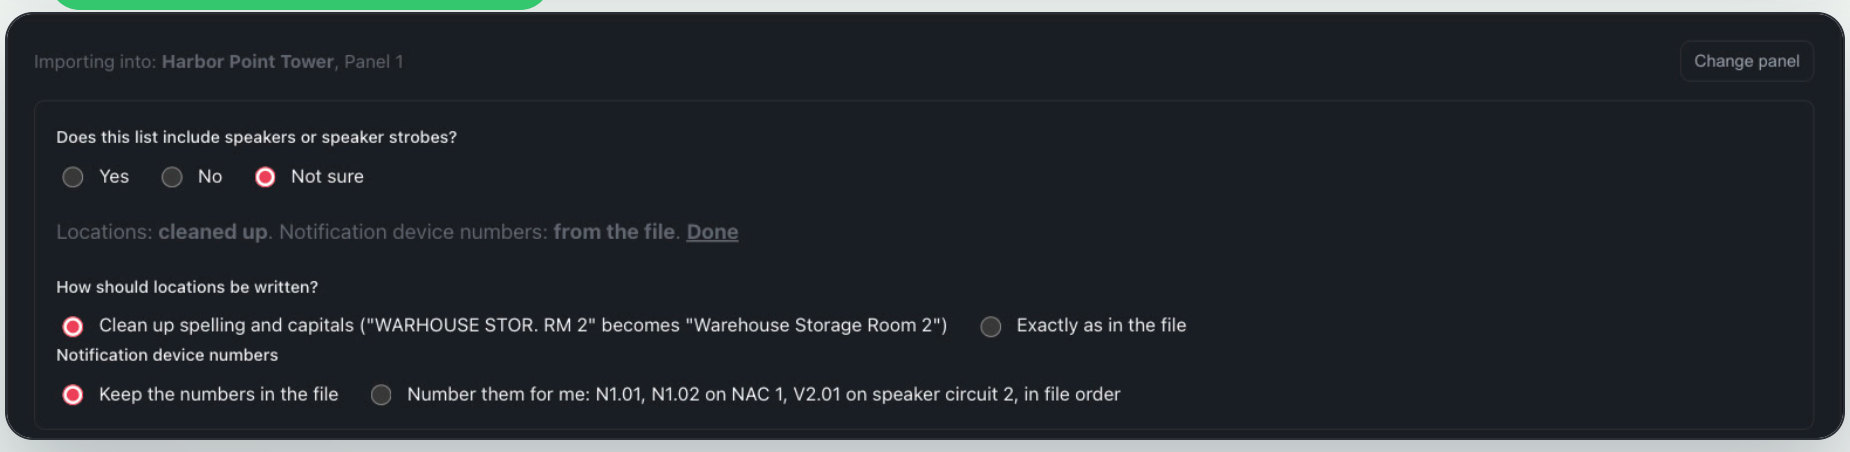

Nothing is added until you confirm it, and your own file is never changed.

Fire and life safety inspection software.
Built by people who do this work.

codegreenitm.com